


Scientific Atlanta¹™ Remote Monitoring Unit Interconnection Quick Start Diagram

SARMU By Keywest Technology™

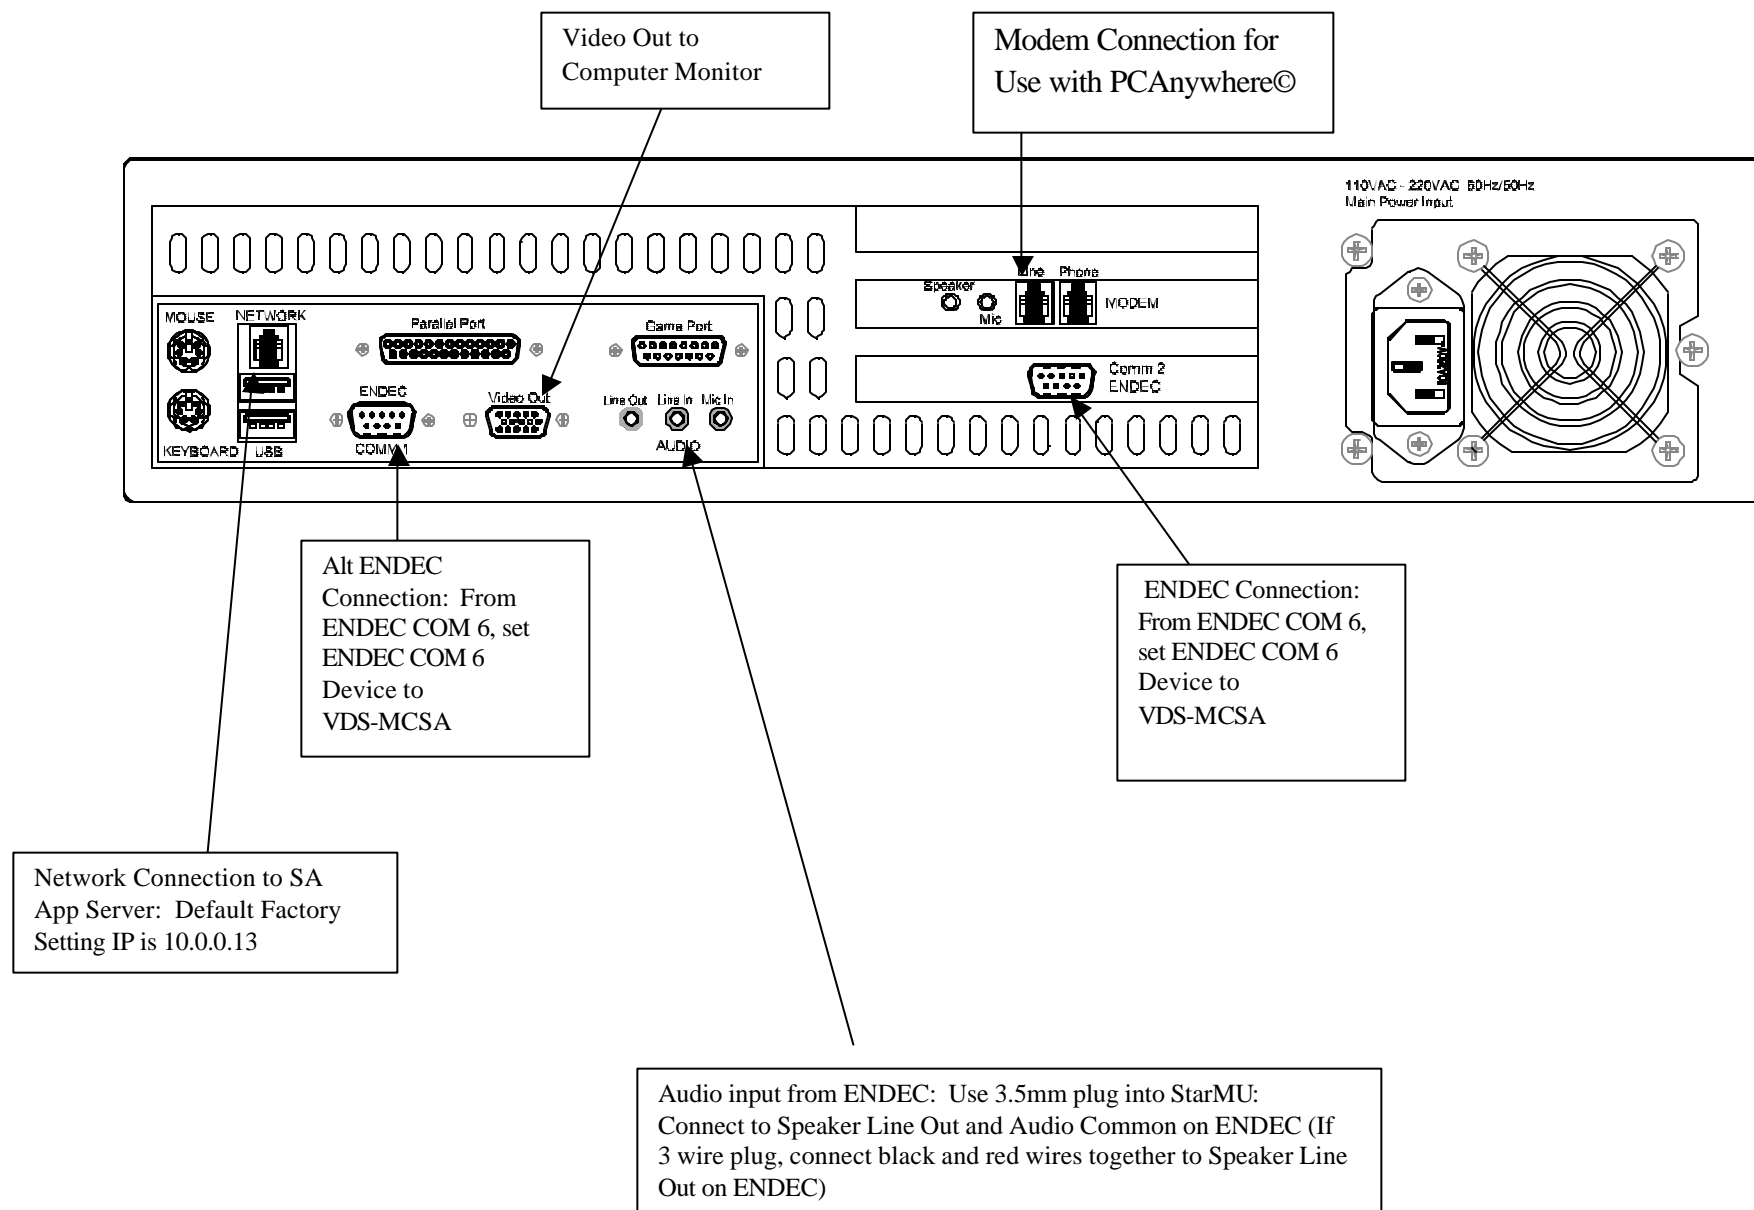

Note that the ENDEC connects to the StarMU with a supplied Null Modem Cable only. Other cables will not make proper link. ENDEC can connect to either Comm 1 or Comm 2. The default factory setting is Comm 2 to connect to ENDEC COM 6 (Digital for Scientific Atlanta™ App Server System)